


Ultra Block[®] 1- 4" Floor



UL[®] Classification
2-Hour Rated

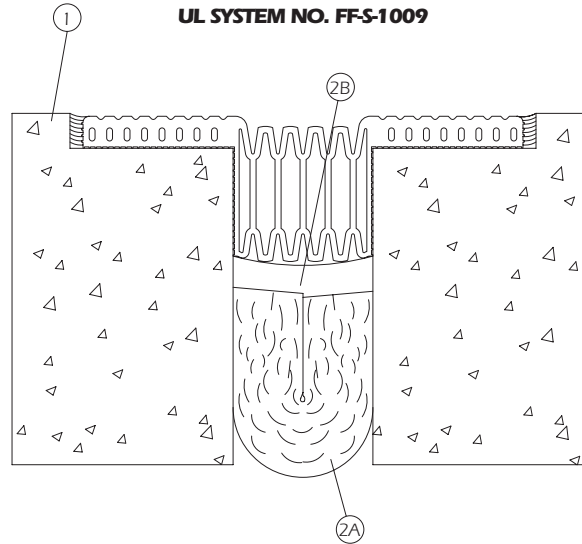

1. **Floor Assembly** Min 4-1/2 in. thick reinforced lightweight or normal weight (100-150 pcf) structural concrete.
2. **Joint System** Max width of joint is 4 in. The joint system shall consist of the following:
 - A. **Forming Material*** Max 11 in. width of forming material shall be folded in half and packed into joint opening as a permanent form. Forming material to be recessed from top surface of floor as required to accommodate the required thickness of fill material.

BACKER ROD MFG INC — ULTRA BLOCK[®]

- B. **Fill, Void or Cavity Material*** Min 1/2 in. thickness of fill material applied within the joint, flush with top surface of floor.

GENERAL ELECTRIC CO

SILICONE PRODUCTS DIV — Pensil 300 or Pensil 300 S/L Sealants

SPECIFIED TECHNOLOGIES INC — Pensil 300 or Pensil 300 S/L Sealants

*Bearing the UL Classification Mark