

Explovent® ERP-TP

*Top or Bottom Hinged, Translucent
Fiberglass Double Wall Explosion Vent*

Application:


Any facility where potentially explosive atmospheres exist and require explosion venting with natural lighting. Facilities handling hazardous materials are required by numerous building codes to provide adequate safeguards against explosions.

Function:

An explosion vent is designed to be the weakest part of the external structure. As the explosion vent detects the pressure rise, it opens quickly allowing the rapidly expanding heated gases to be released to the outside.

Technical Features and Options:

- ERP-TP meets '98 NFPA 68 Guide for Venting of Deflagrations and major building and fire code requirements.
- Translucent double walled system with internal structure grid provides a uniquely handsome appearance for those applications where the "industrial look" just doesn't cut it.
- Lightweight, high strength construction allows for quick venting and facility protection.
- System can be field tested for release through non-destructive means.
- Resettable panels: Hinged design and permanent magnetic release allow the system to be closed easily and quickly after an event.
- Limits repair, replacement, and downtime costs common to standard explosion release fastener applications.
- Translucent panels brighten workspaces while reducing artificial lighting requirements.
- Smooth beveled surfaces reduce dust accumulation and allow for ease of cleaning, a key to reducing secondary explosions.

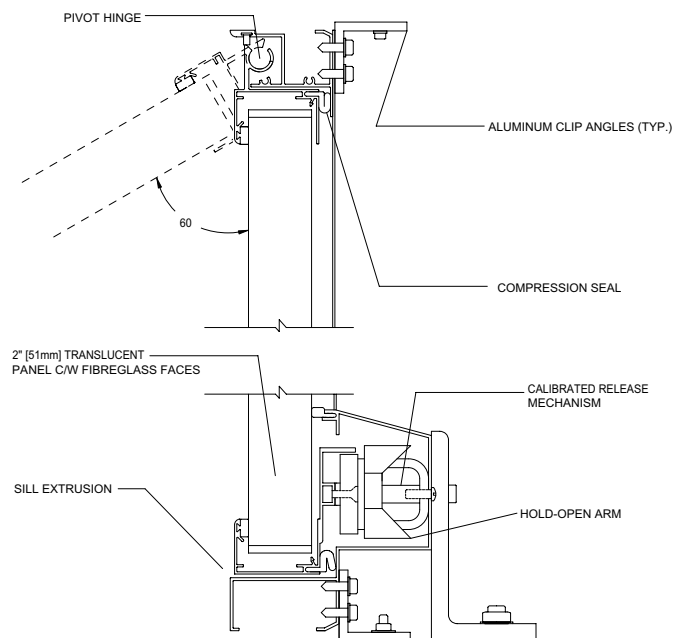

ERP-T-TP

SPEC SECTION 13074

PART 1 GENERAL

1.01 Section Includes

A. Furnish all pressure relief panels, frames, and attachment hardware necessary to complete the work as indicated on the drawings, and as described in the specification.

1.02 Related Sections

- A. Steel Framing Section
- B. Flashing and Sheet metal Section
- C. Sealants Section

1.05 References

- A. Aluminum Association, Section 1, Specifications for Aluminum Structures.
- B. AAMA-603 Voluntary Performance Requirements and Test Procedures for Pigmented Organic Coatings on Aluminum Extrusions.
- C. ASTM-D35 Standard Test Method for Rate of Burning and/or Extent and Time of Burning of Self-supporting Plastics in Horizontal Position.
- D. ASTM-E-84 Standard Test Method for Surface Burning Characteristics of Building Materials.
- E. NFPA 68 Guide for Venting of Deflagrations, 1999 Edition.
- F. Factory Mutual Engineering Corporation, 1-44, Damage-Limiting Construction, July 1991.

1.04 System Description

- A. Pressure relief panel system shall be designed and shop calibrated to release at static pressure differential between interior and exterior of _____ lb/ft² (_____ pascals) $\pm 10\%$.
- B. The panels and structural supports shall be designed to withstand a maximum wind load of 30 lb/ft² (1436 pascals).
- C. Each panels shall be equipped with a restraint/hold open mechanism designed to cushion the panel's deceleration as the full open position is reached; and to minimize the development of a vacuum in the enclosure when the heated gases cool.
- D. Panels with a 2" insulated core shall be tested by Factory Mutual or CANMET. Dynamic test data shall demonstrate that the panel release, restraint, and hold open mechanisms performed properly, the panels were not structurally damaged, and the panels could be reset. In addition, the test data shall include all pertinent operating conditions under which the test was conducted including static release

pressure and the additional pressure rise within the chamber

E. System design shall allow for non-destructive testing in the field to verify that the panel's release at the specified static design pressure.

F. The panel pressure relief system allows for manual retrieval after release.

G. The weight of the fabricated panel shall not exceed 2.5 lb/ft² (12.2 kg/m²).

1.05 Submittals

A. The manufacturer for approval prior to fabrication shall submit complete shop drawings. Drawings shall show product location, fabrication details, specified static release loads, and static release forces.

B. Installation instructions shall be submitted with the shop drawings.

1.06 Quality Testing

A. The panel system shall be produced by a manufacturer regularly engaged in manufacture of similar products and with a verifiable history of successful product applications.

B. Products equal to this specification in design, performance, and testing shall be considered, providing they are submitted for approval at least 10 days prior to bid. Submittal for approval shall include product literature, and details, product samples, and verification of non-destructive field-testing capabilities. Failure to comply with these requirements shall be cause for rejection.

1.07 Delivery, Storage, and Handling

A. Deliver to site in original, unopened containers and/or pallets bearing manufacturer's name and label.

1.08 Limited Warranty

A. All Explovent® products are sold with a standard limited warranty, copy of which is available at our main office.

PART 2 PRODUCTS

2.01 Manufacturers

A. Model: ERP-TP, Explovent pressure relief panel systems shall be manufactured by Conspec Systems, Inc. Cranford, NJ; or C/S Construction Specialties Company, Mississauga, Ontario.

C. Each panel shall be shop calibrated and tested for proper operation and for release at the design loads specified on the approved drawings.

D. All panels shall be permanently marked with the design release pressure and the maximum-static release force.

E. Manufacturer shall have complete in-house finishing capabilities.

2.02 Materials

A. Panels shall be 2" thick and consist of architectural grade glass fiber reinforced polymer faces bonded to an interlocked aluminum I-beam grid core. Color to be white.

B. Panel framing components shall be .063" 6063-T-52 alloy extruded aluminum. All fasteners shall be aluminum or stainless steel.

C. Exterior panel gaskets shall be the pile fiber type with a continuous polypropylene center fin. Interior gaskets shall consist of open cell compression foam and clad with polypropylene liner.

2.03 Fabrications

A. Fabricate the ERP-T-TP or ERP-B-TP pressure relief panels to the sizes shown on the approved shop drawings.

B. Panels shall be top hinged or bottom hinged as detailed.

C. All panels, frames, and release mechanisms shall be factory assembled in units and shipped to the job site.

D. Mullions to be two-piece interlocking assemblies, which allow for expansion and contraction, and for individual panel removeability.

E. All panels shall have exterior pile gaskets and interior compression (or magnetic) gaskets to minimize air leakage and water entrapment when closed.

F. The release mechanism shall be mounted to the panel frame, and shall be shop calibrated and tested for the design loads specified on the approved drawings.

2.04 Factory Finishing

A. Kynar 500®: Panels and frames shall be finished in full strength, 70% resin Kynar 500® Fluoropolymer Coating consisting of prime coat and color coat minimum 1 mil (.025mm) thick.

B. Color to be selected from manufacturer's standard color selections.

PART 3 EXECUTION

3.01 Installation

A. The vents must be installed in accordance with shop drawings, the installation instructions, and any special instructions on the shop drawing.

C/S GROUP OF COMPANIES

MANUFACTURING/SALES/DISTRIBUTION LOCATIONS

U.S.A. Conspec Systems, Inc., Cranford, NJ Tel:(800)222-0201 Fax:(800)293-4509

Canada C/S Construction Specialties Company, Mississauga, Ont. Tel:(905)274-3611 Fax:(905)274-6241

For Phone Number of Nearest Representative, Call Toll Free (800)222-0201 (U.S.A.) and (888)895-8955 (Canada only).

For Assistance with Overseas Requirements, Fax C/S International (908)236-2903.

©Copyright 2001 Conspec Systems, Inc. Reserves the Right to Make Design Changes or to Withdraw Any Design Without Notice.

Printed in U.S.A.