

MODEL DCV-5704

C/S 5"(127.0 mm) STORM RESISTANT DADE COUNTY HURRICANE VERTICAL LOUVER

Construction Specialties Inc. certifies that the louver model DCV-5704 shown herein is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to Wind Driven Rain ratings, and Air Performance ratings.

APPLICATION AND DESIGN:

DCV-5704 is tested in accordance with AMCA 500-L Air Performance and Wind Driven Rain. DCV-5704 is tested in accordance with AMCA 540 Test Method for Louvers Impacted by Wind Borne Debris (Basic Protection, Missile Level D and Enhanced Protection, Missile Level E). Minimum louver section size to be 8" x 18".

DESIGN DATA:

To maintain a CLASS A (99%) effectiveness rating

- with a 29.1 mph wind speed and rainfall rate of 3 in/hr*
- Maximum intake core velocity 5.0 m/s (986 FPM)
- Maximum intake free area velocity 10.0 m/s (1,956 FPM)

To maintain a CLASS A (99%) effectiveness rating

with a 50 mph wind speed and rainfall rate of 8 in/hr*

Maximum intake core velocity 4.5 m/s (856 FPM)

Maximum intake free area velocity 8.6 m/s (1698 FPM) *louver tested with 1m² core area, mill finish and no screen

DADE COUNTY PROTOCOLS:

TAS-201: Large and small missile impact TAS-202: Criteria for testing impact and not impact resistant building Envelope components using static uniform air pressure TAS-203: Criteria for testing products subject to cyclic wind pressure N.O.A. #14-1021.13 Florida Product Approval #21969 Maximum Design Windload 150 PSF



Intake Cd = 0.33 (Class 2) AMCA certifies the coefficient class only






SUGGESTED SPECIFICATIONS:


GENERAL: Furnish and install where indicated on the drawings C/S 5" (127.0 mm) STORM RESISTANT DADE COUNTY HURRICANE VERTICAL LOUVER MODEL DCV-5704 as manufactured by Construction Specialties, Inc., Cranford, NJ. Complete details shall be submitted to the architect for approval prior to fabrication.

MATERIAL: Frames and blades to be fabricated from 6063-T6 aluminum alloy. Blades to be minimum 0.060" (1.52mm) thick and frames to be minimum 0.075" (1.91 mm) thick. Louver to be mechanically fastened using stainless steel or aluminum fasteners. Louvers to be supplied with 4" (101.6 mm) high by full depth sill flashing formed from minimum 0.050" (1.27 mm) thick aluminum. Sill flashing to have welded side panels. Louvers and sill flashing to be installed in accordance with the manufacturer's recommended procedures to ensure complete water integrity performance of louver system. All louvers to be furnished with 5/8" (15.87 mm) flattened expanded mesh, aluminum bird screen with a 0.055" (1.4 mm) thick extruded aluminum frame.

STRUCTURAL DESIGN: Louvers must be tested in accordance with Dade County protocols TAS-201, TAS-202, TAS-203. Louvers shall be Dade County approved for open structure building envelope protection (including missile), for single unit sizes up to 12 feet wide by 6 1/2 feet high. To maintain Dade County product approval status, the louvers must be attached to a structural substrate in accordance with the Dade County Product Approval Drawings. In addition, the structural substrate to which the louvers are attached must be designed to withstand the point loads transferred by the louvers when subjected to the design wind loads.

FINISH: All louvers shall be finished with C/S Powder Coat, a coating to be 1.5 to 3 mil. thick full strength 100% resin Fluoropolymer coating. Finish to allow zero VOCs to be emitted into facility of application. Finish to adhere to a 4H Hardness rating. All finishing procedures shall be one continuous operation in the plant of the manufacturer. The coating shall meet or exceed all requirements of AAMA specification 2605 "Voluntary Specification for High Performance Organic Coatings on Architectural extrusions and Panels." The louver manufacturer shall supply an industry standard 20year limited warranty against failure or excessive fading of the Fluoropolymer Powder Coat finish. This limited warranty shall begin on the date of material shipment.







LOUVER

IMPACT RESISTANT Enhanced Protection

This See www.AMCA.ora for all certified or listed products

Construction Specialties Inc. certifies that the louver model DCV-5704 shown herein is approved to bear the AMCA Listing Label. The ratings shown are based on tests and procedures performed in accordance with AMCA Publications and comply with the requirements of the AMCA Listing Label Program. The AMCA Listing Label applies to Wind Borne Debris Impact Louvers.

PERFORMANCE DATA MODEL DCV-5704

WIND DRIVEN RAIN PERFORMANCE:

The louver test was based on a $39.370''(1.00 \text{ m}) \times 39.370''(1.00 \text{ m})$ core area unit tested at a rainfall rate of 3" per hour (75 mm/hr) and with a wind directed to the face of the louver at a velocity of 29.1-mph (13 m/s) as well as a rainfall rate of 8" per hour (203mm) and wind directed at the face of the louver at a velocity of 50.0 mph (22.3 m/s). The test data shall show the water penetration effectiveness rating at each corresponding ventilation rate.


Core Ventilation Rate (m/s):	0.0	0.5	1.0	1.5	2.0	2.5	3.0	3.5	4.0	4.5	5.0
Core Ventilation Rate (ft/min) 29 & 3:	0	132	197	287	380	472	587	680	780	874	986
Free Area Velocity (ft/min) 29 & 3:	0	261	391	569	754	937	1165	1349	1548	1734	1956
Rating Effectiveness @ 29 & 3	Α	Α	Α	Α	Α	Α	Α	Α	Α	Α	Α
Effectiveness Ratio @ 29 & 3 (%)										100	99.8
Core Ventilation Rate (ft/min) 50 & 8:	0	96	194	284	400	496	571	676	782	856	977
Free Area Velocity (ft/min) 50 & 8:	0	190	385	563	794	984	1133	1341	1552	1698	1939
Rating Effectiveness @ 50 & 8	Α	Α	Α	Α	Α	Α	Α	Α	Α	Α	B
Effectiveness Ratio @ 50 & 8 (%)								99.7	99.5	99.1	98.2
Effectiveness Rating:	A = 1 to	A = 1 to 0.99		B = 0.989 to 0.95		C = 0.949 to 0.80		D = 0.799 to 0			

Water Penetration Statement

Width in Inches and Meters

	8	12	18	24	30	36	42	48	54	60
	0.20	0.30	0.46	0.61	0.76	0.91	1.07	1.22	1.37	1.52
18	0.23	0.46	0.81	1.15	1.50	1.84	2.19	2.53	2.88	3.23
0.46	0.02	0.04	0.07	0.11	0.14	0.17	0.20	0.24	0.27	0.30
24	0.32	0.64	1.11	1.59	2.06	2.54	3.02	3.49	3.97	4.45
0.61	0.03	0.06	0.10	0.15	0.19	0.24	0.28	0.32	0.37	0.41
30	0.40	0.81	1.42	2.02	2.63	3.24	3.84	4.45	5.06	5.66
0.76	0.04	0.08	0.13	0.19	0.24	0.30	0.36	0.41	0.47	0.53
36	0.49	0.98	1.72	2.46	3.20	3.93	4.67	5.41	6.15	6.88
0.91	0.05	0.09	0.16	0.23	0.30	0.37	0.43	0.50	0.57	0.64
42	0.58	1.16	2.03	2.89	3.76	4.63	5.50	6.37	7.23	8.10
1.07	0.05	0.11	0.19	0.27	0.35	0.43	0.51	0.59	0.67	0.75
48	0.67	1.33	2.33	3.33	4.33	5.33	6.33	7.32	8.32	9.32
1.22	0.06	0.12	0.22	0.31	0.40	0.49	0.59	0.68	0.77	0.87
54	0.75	1.51	2.64	3.76	4.89	6.02	7.15	8.28	-	10.54
1.37	0.07	0.14	0.24	0.35	0.45	0.56	0.66	0.77	0.87	0.98
60	0.84	1.68	2.94	4.20	5.46	6.72	7.98		10.50	
1.52	0.08	0.16	0.27	0.39	0.51	0.62	0.74	0.86	0.98	1.09
66	0.93	1.85	3.25	4.64	6.03	7.42			11.59	
1.68	0.09	0.17	0.30	0.43	0.56	0.69	0.82	0.95	1.08	1.21
72	1.01	2.03	3.55	5.07	6.59	8.11			12.68	
1.83 78	0.09	0.19	0.33	0.47	0.61	0.75 8.81	0.90	1.04	1.18 13.77	1.32
1.98	0.10	2.20 0.20	3.85 0.36	5.51 0.51	7.16 0.67	0.82	0.97	12.11	1.28	15.42
84	1.19	2.38	4.16	5.94	7.72				14.86	
2.13	0.11	0.22	0.39	0.55	0.72	0.88	1.05	1.21	1.38	1.55
90	1.28	2.55	4.46	6.38		10.20			15.94	
2.29	0.12	0.24	0.41	0.59	0.77	0.95	1.13	1.30	1.48	1.66
96	1.36	2.73	4.77	6.81					17.03	
2.44	0.13	0.25	0.44	0.63	0.82	1.01	1.20	1.39	1.58	1.77
102	1.45	2.90	5.07	7.25					18.12	
2.59	0.13	0.27	0.47	0.67	0.88	1.08	1.28	1.48	1.68	1.89
108	1.54	3.07	5.38	7.68					19.21	
2.74	0.14	0.29	0.50	0.71	0.93	1.14	1.36	1.57	1.78	2.00
114	1.62	3.25	5.68	8.12	10.56	12.99	15.43	17.86	20.30	22.73
2.90	0.15	0.30	0.53	0.75	0.98	1.21	1.43	1.66	1.89	2.11
120	1.71	3.42	5.99	8.55	11.12	13.69	16.25	18.82	21.39	23.95
3.05	0.16	0.32	0.56	0.79	1.03	1.27	1.51	1.75	1.99	2.23
Uppe	Upper Numerals English Units/Lower Numerals Metric Units									

AMCA defines the point of beginning water penetration as the free area velocity at which the AMCA water test has yielded 0.01 or less ounces of water per square foot of louver free area during a 15-minute test period.

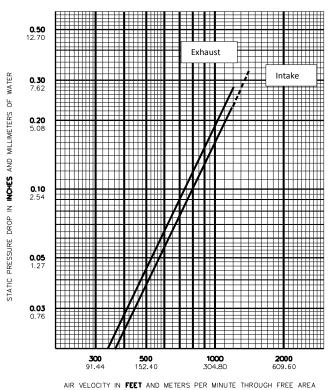

For a 48" X 48" sized louver tested to figure 5.5. Data corrected to standard air density.

Construction Specialties, Inc. Manufacturing & Sales Location www.c-sgroup.com

To download details and specifications visit www.c-sgroup.com

For assistance with overseas requirements, call C/S International (908) 236-0800

©Copyright April 2017. Construction Specialties, Inc., reserves the right to make design changes or to withdraw any design without notice.