


Construction Specialties Inc. certifies that the louver model GS-607 shown herein is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified ratings Program. The AMCA Certified Ratings Seal applies to air performance ratings and water penetration ratings.

**AIRFLOW DATA:**

**For a 4 Foot by 4 Foot Unit**

- Free area = 8.46 ft<sup>2</sup> (0.786 m<sup>2</sup>)
- Percent Free Area = 53 %
- Free area velocity at the point of beginning water penetration (@ 0.01oz./ft<sup>2</sup>) = 945 FPM (4.80 m/s)
- Maximum recommended air intake velocity = 745 FPM (3.78 m/s)  
Air Volume @ 745 FPM free area velocity = 6303 CFM (2.97 m<sup>3</sup>/s)  
Pressure Drop @ 745 FPM intake velocity = 0.08 in. H<sub>2</sub>O (19.8 Pa)
- Maximum recommended air exhaust velocity = 2182 FPM (11.08 m/s)  
Air Volume @ 2182 FPM free area velocity = 18459 CFM (8.71 m<sup>3</sup>/s)  
Pressure Drop @ 2180 FPM exhaust velocity = 0.50 in. H<sub>2</sub>O (124.1 Pa)

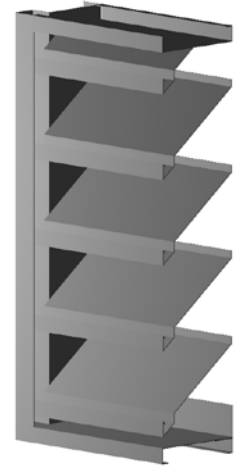

**SUGGESTED SPECIFICATIONS:**

**GENERAL:** Furnish and install where indicated on the drawings C/S 6" (152.4 mm) STANDARD FIXED GALVANIZED STEEL LOUVER MODEL GS-607 as manufactured by Construction Specialties, Inc., Cranford, NJ or Mississauga, Ontario. Louvers shall be constructed entirely of galvanized steel. Complete details shall be submitted to the architect for approval prior to fabrication. Supplier must be a member of AMCA or BSRIA



**MATERIAL:** Heads, sills, jambs, and mullions to be one piece structural members of galvanized steel. Mullions and jambs shall have integral internal drains. Member thicknesses to be any combination of 16 gauge (1.52 mm), 18 gauge (1.21 mm), or 20 gauge (0.91 mm) material. Blades shall be fastened to each jamb frame and vertical member with two fillet welds produced with the Metal Inert Gas (MIG) welding process with a minimum 0.125" (3.18 mm) throat. Frames shall be joined at each corner with a full length MIG filled weld. All louvers to be furnished with 5/8" (15.87 mm) flattened expanded mesh, aluminum bird screen with a .055" (1.4 mm) thick extruded aluminum frame.

**STRUCTURAL DESIGN:** Structural supports shall be designed and furnished by the Louver manufacturer to carry a wind load of not less than \_\_\_\_\_ psf. (kPa) (Note: if this paragraph is omitted or if the design wind load is not specified the Louvers will be manufactured in self supporting units up to a maximum of 5' wide by 8' high. Any additional structural supports required to adequately secure these units within the opening shall be the responsibility of others.

**TEST DATA:** The Louver Manufacturer shall submit test on a 4'x 4' unit showing that the Louver conforms to the following.

Free Area:	8.46 ft <sup>2</sup> (0.786 m <sup>2</sup> )
Free area velocity at point of beginning water penetration (0.01 oz./ft <sup>2</sup> ):	945 FPM (4.80 m/s)
Intake pressure drop at 0.01 oz./ft <sup>2</sup> free area velocity:	0.13 in. H <sub>2</sub> O (32.3 Pa)
Exhaust pressure drop at 1000 FPM free area velocity (305m/min):	0.11 in. H <sub>2</sub> O (26.1 Pa)

**FINISH:** All louvers shall be finished with C/S Powder Coat, a coating to be 1.5 to 3 mil. thick full strength **100% resin Fluoropolymer coating**. **Finish to allow zero VOCs** to be emitted into facility of application. Finish to adhere to a 4H Hardness rating. All finishing procedures shall be one continuous operation in the plant of the manufacturer.

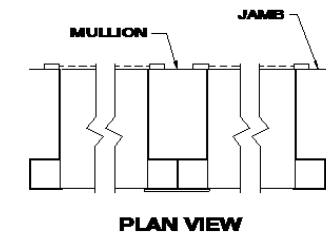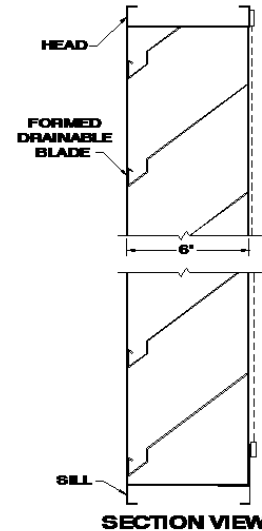

Discharge Coefficient  
**Intake Cd = 0.41 (Class2)**  
AMCA certifies the coefficient class only

# PERFORMANCE DATA MODEL GS-607


## Width in Inches and Meters

	18	24	30	36	42	48	54	60
	0.46	0.61	0.76	0.91	1.07	1.22	1.37	1.52
<b>18</b>	<b>0.84</b>	<b>1.18</b>	<b>1.52</b>	<b>1.86</b>	<b>2.20</b>	<b>2.54</b>	<b>2.88</b>	<b>3.23</b>
0.46	0.08	0.11	0.14	0.17	0.20	0.24	0.27	0.30
<b>24</b>	<b>1.12</b>	<b>1.57</b>	<b>2.02</b>	<b>2.48</b>	<b>2.93</b>	<b>3.38</b>	<b>3.84</b>	<b>4.29</b>
0.61	0.10	0.15	0.19	0.23	0.27	0.31	0.36	0.40
<b>30</b>	<b>1.54</b>	<b>2.16</b>	<b>2.79</b>	<b>3.41</b>	<b>4.04</b>	<b>4.66</b>	<b>5.29</b>	<b>5.91</b>
0.76	0.14	0.20	0.26	0.32	0.37	0.43	0.49	0.55
<b>36</b>	<b>1.97</b>	<b>2.77</b>	<b>3.58</b>	<b>4.38</b>	<b>5.18</b>	<b>5.98</b>	<b>6.79</b>	<b>7.59</b>
0.91	0.18	0.26	0.33	0.41	0.48	0.56	0.63	0.70
<b>42</b>	<b>2.41</b>	<b>3.39</b>	<b>4.37</b>	<b>5.35</b>	<b>6.33</b>	<b>7.31</b>	<b>8.29</b>	<b>9.26</b>
1.07	0.22	0.31	0.41	0.50	0.59	0.68	0.77	0.86
<b>48</b>	<b>2.85</b>	<b>4.01</b>	<b>5.18</b>	<b>6.34</b>	<b>7.50</b>	<b>8.66</b>	<b>9.82</b>	<b>10.98</b>
1.22	0.27	0.37	0.48	0.59	0.70	0.79	0.91	1.02
<b>54</b>	<b>3.27</b>	<b>4.61</b>	<b>5.94</b>	<b>7.27</b>	<b>8.60</b>	<b>9.94</b>	<b>11.27</b>	<b>12.60</b>
1.37	0.30	0.43	0.55	0.68	0.80	0.92	1.05	1.17
<b>60</b>	<b>3.71</b>	<b>5.22</b>	<b>6.73</b>	<b>8.24</b>	<b>9.75</b>	<b>11.26</b>	<b>12.77</b>	<b>14.28</b>
1.52	0.34	0.48	0.63	0.77	0.91	1.05	1.19	1.33
<b>66</b>	<b>4.15</b>	<b>5.83</b>	<b>7.52</b>	<b>9.21</b>	<b>10.89</b>	<b>12.58</b>	<b>14.27</b>	<b>15.95</b>
1.68	0.39	0.54	0.70	0.86	1.01	1.17	1.33	1.48
<b>72</b>	<b>4.58</b>	<b>6.45</b>	<b>8.31</b>	<b>10.17</b>	<b>12.04</b>	<b>13.90</b>	<b>15.77</b>	<b>17.63</b>
1.83	0.43	0.60	0.77	0.95	1.12	1.29	1.46	1.64
<b>78</b>	<b>4.83</b>	<b>6.80</b>	<b>8.77</b>	<b>10.73</b>	<b>12.70</b>	<b>14.66</b>	<b>16.63</b>	<b>18.60</b>
1.98	0.45	0.63	0.81	1.00	1.18	1.36	1.55	1.73
<b>84</b>	<b>5.29</b>	<b>7.44</b>	<b>9.59</b>	<b>11.74</b>	<b>13.89</b>	<b>16.04</b>	<b>18.19</b>	<b>20.34</b>
2.13	0.49	0.69	0.89	1.09	1.29	1.49	1.69	1.89
<b>90</b>	<b>5.72</b>	<b>8.04</b>	<b>10.37</b>	<b>12.69</b>	<b>15.02</b>	<b>17.34</b>	<b>19.67</b>	<b>21.99</b>
2.29	0.53	0.75	0.96	1.18	1.40	1.61	1.83	2.04
<b>96</b>	<b>6.13</b>	<b>8.62</b>	<b>11.11</b>	<b>13.61</b>	<b>16.10</b>	<b>18.59</b>	<b>21.09</b>	<b>23.58</b>
2.44	0.57	0.80	1.03	1.26	1.50	1.73	1.96	2.19
<b>102</b>	<b>6.57</b>	<b>9.25</b>	<b>11.92</b>	<b>14.59</b>	<b>17.27</b>	<b>19.94</b>	<b>22.61</b>	<b>25.29</b>
2.59	0.61	0.86	1.11	1.36	1.60	1.85	2.10	2.35
<b>108</b>	<b>7.02</b>	<b>9.87</b>	<b>12.73</b>	<b>15.58</b>	<b>18.44</b>	<b>21.29</b>	<b>24.15</b>	<b>27.00</b>
2.74	0.65	0.92	1.18	1.45	1.71	1.98	2.24	2.51
<b>114</b>	<b>7.45</b>	<b>10.49</b>	<b>13.52</b>	<b>16.55</b>	<b>19.58</b>	<b>22.62</b>	<b>25.65</b>	<b>28.68</b>
2.90	0.69	0.97	1.26	1.54	1.82	2.10	2.38	2.66
<b>120</b>	<b>7.89</b>	<b>11.10</b>	<b>14.31</b>	<b>17.52</b>	<b>20.73</b>	<b>23.94</b>	<b>27.15</b>	<b>30.36</b>
3.05	0.73	1.03	1.33	1.63	1.93	2.22	2.52	2.82
<b>126</b>	<b>8.18</b>	<b>11.51</b>	<b>14.84</b>	<b>18.16</b>	<b>21.49</b>	<b>24.82</b>	<b>28.15</b>	<b>31.47</b>
3.20	0.76	1.07	1.38	1.69	2.00	2.31	2.61	2.92
<b>132</b>	<b>8.59</b>	<b>12.08</b>	<b>15.58</b>	<b>19.07</b>	<b>22.56</b>	<b>26.06</b>	<b>29.55</b>	<b>33.04</b>
3.35	0.80	1.12	1.45	1.77	2.10	2.42	2.75	3.07
<b>138</b>	<b>9.02</b>	<b>12.69</b>	<b>16.37</b>	<b>20.04</b>	<b>23.71</b>	<b>27.38</b>	<b>31.05</b>	<b>34.72</b>
3.51	0.84	1.18	1.52	1.86	2.20	2.54	2.88	3.23
<b>144</b>	<b>9.46</b>	<b>13.31</b>	<b>17.16</b>	<b>21.00</b>	<b>24.85</b>	<b>28.70</b>	<b>32.55</b>	<b>36.40</b>
3.66	0.88	1.24	1.59	1.95	2.31	2.67	3.02	3.38
<b>150</b>	<b>9.92</b>	<b>13.95</b>	<b>17.99</b>	<b>22.02</b>	<b>26.06</b>	<b>30.09</b>	<b>34.13</b>	<b>38.16</b>
3.81	0.92	1.30	1.67	2.05	2.42	2.80	3.17	3.55
<b>156</b>	<b>10.32</b>	<b>14.52</b>	<b>18.72</b>	<b>22.91</b>	<b>27.11</b>	<b>31.31</b>	<b>35.51</b>	<b>39.71</b>
3.96	0.96	1.35	1.74	2.13	2.52	2.91	3.30	3.69
<b>162</b>	<b>10.75</b>	<b>15.12</b>	<b>19.50</b>	<b>23.87</b>	<b>28.24</b>	<b>32.61</b>	<b>36.99</b>	<b>41.36</b>
4.11	1.00	1.40	1.81	2.22	2.62	3.03	3.44	3.84
<b>168</b>	<b>11.20</b>	<b>15.75</b>	<b>20.31</b>	<b>24.86</b>	<b>29.42</b>	<b>33.97</b>	<b>38.53</b>	<b>43.08</b>
4.27	1.04	1.46	1.89	2.31	2.73	3.16	3.58	4.00
<b>174</b>	<b>11.62</b>	<b>16.35</b>	<b>21.08</b>	<b>25.80</b>	<b>30.53</b>	<b>35.26</b>	<b>39.99</b>	<b>44.71</b>
4.42	1.08	1.52	1.96	2.40	2.84	3.28	3.71	4.15
<b>180</b>	<b>11.90</b>	<b>16.74</b>	<b>21.58</b>	<b>26.42</b>	<b>31.26</b>	<b>36.10</b>	<b>40.94</b>	<b>45.78</b>
4.57	1.11	1.56	2.00	2.45	2.90	3.35	3.80	4.25
<b>186</b>	<b>12.33</b>	<b>17.35</b>	<b>22.36</b>	<b>27.38</b>	<b>32.40</b>	<b>37.41</b>	<b>42.43</b>	<b>47.45</b>
4.72	1.15	1.61	2.08	2.54	3.01	3.48	3.94	4.41
<b>192</b>	<b>12.77</b>	<b>17.96</b>	<b>23.16</b>	<b>28.35</b>	<b>33.54</b>	<b>38.74</b>	<b>43.93</b>	<b>49.12</b>
4.88	1.19	1.67	2.15	2.63	3.12	3.60	4.08	4.56
<b>198</b>	<b>13.19</b>	<b>18.56</b>	<b>23.93</b>	<b>29.29</b>	<b>34.66</b>	<b>40.03</b>	<b>45.39</b>	<b>50.76</b>
5.03	1.23	1.72	2.22	2.72	3.22	3.72	4.22	4.72

Height in Inches and Meters

## Water Penetration Statement

AMCA defines the point of beginning water penetration as the free area velocity at which the AMCA water test has yielded 0.01 or less ounces of water per square foot of louver free area during a 15-minute test period.

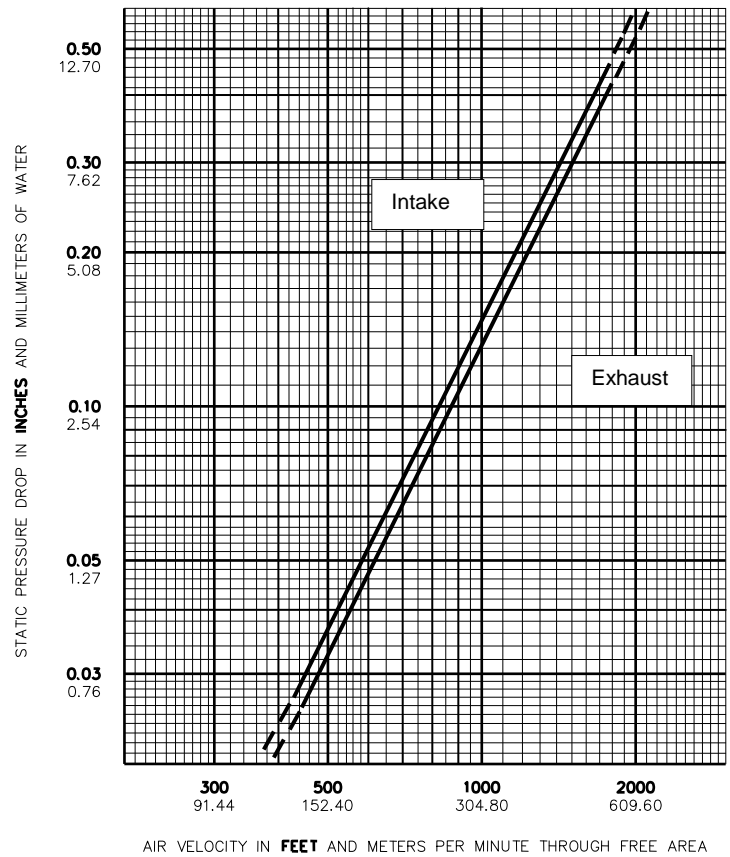

For a 48" X 48" sized louver

**Construction Specialties, Inc.**  
**Manufacturing & Sales Locations**  
[www.c-sgroup.com](http://www.c-sgroup.com)

Cranford, New Jersey  
 49 Meeker Avenue 07016  
 Telephone: (800) 631-7379  
 Fax: (908) 272-2920

Mississauga, Ontario  
 895 Lakefront Promenade L5E 2C2  
 Telephone: (888) 895-8955  
 Fax: (905) 274-6241

Upper Numerals English Units/Lower Numerals Metric Units

*A member of the C/S Group of Companies*  
 For assistance with overseas requirements, call  
 C/S International (908) 236-0800

©Copyright April 2010. Construction Specialties, Inc., reserves the right to make design changes or to withdraw any design without notice.